

PLAN No. 177

Original

Received FEB 10 1888

1

APPLICATION TO ALTER, REPAIR, ETC.

B405  
L41

Application is hereby made to alter as per subjoined detailed statement of specification for Alterations, Additions or Repairs to buildings already erected, and I herewith submit Plans and Drawings of such proposed alterations; and I do hereby agree that the provisions of the Building Law will be complied with, whether the same are specified herein or not.

(Sign here) *Frederic W. Gris. Arch*

NEW YORK, *Feb 10<sup>th</sup>* 1888

- 1. State how many buildings to be altered, *One*
- 2. What is the street or avenue and the number thereof? *573 East 11<sup>th</sup> St.*
- 3. How much will the alteration cost, \$ *1200<sup>00</sup>*

GIVE THE FOLLOWING INFORMATION AS TO THE PRESENT BUILDING:

- 1. Size of lot on which it is located, No. feet front, *20*; feet rear, *20*; feet deep, *100*
- 2. Size of building, No. of feet front, *20*; feet rear, *20*; feet deep, *46*; No. of stories in height, *4*; *cellar* No. of feet in height, from curb level to highest point of beams, *43*
- 3. Material of building, *Brk*; material of front, *Brk*
- 4. Whether roof is peak, flat, or mansard? *flat*
- 5. Depth of foundation walls *10* feet; thickness of foundation walls, *16*; materials of foundation walls, *Brk*
- 6. Thickness of upper walls, *12* inches. Material of upper walls, *Brk*
- 7. Whether independent or party-walls, *Independent*
- 8. How the building is occupied, *Dwelling*

IF TO BE RAISED OR BUILT UPON, GIVE THE FOLLOWING INFORMATION:

- 1. How many stories will the building be when raised? .....
- 2. How high will the building be when raised? .....
- 3. Will the roof be flat, peak or mansard? .....
- 4. What will be the thickness of wall of additional stories? ..... story, ..... inches; ..... story, ..... inches.
- 5. Give size and material of floor beams of additional stories; ..... 1st tier, ..... x .....; ..... 2d tier, ..... x ..... Distance from centres on ..... tier, ..... inches; ..... tier ..... inches.
- 6. How will the building be occupied? .....

IF TO BE EXTENDED ON ANY SIDE, GIVE THE FOLLOWING INFORMATION:

- 1. Size of extension, No. feet front, .....; feet rear, .....; feet deep, .....; No. of stories in height, .....; No. of feet in height, .....
- 2. What will be the material of foundation walls of extension, ..... What will be the depth, ..... feet. What will be the thickness, ..... inches.
- 3. Will foundation be laid on earth, rock, timber or piles, .....


IF TO BE EXTENDED ON ANY SIDE, GIVE THE FOLLOWING INFORMATION:

4. What will be the base—stone or concrete? ..... If base stones, give size, and how laid  
..... If concrete, give thickness, .....
5. What will be the sizes of piers? .....
6. What will be the thickness of upper walls in 1st story ..... inches; 2d story, ..... inches;  
3d story, ..... inches; from thence to top, ..... inches; and of what materials to  
be constructed, .....
7. Whether independent or party-walls; if party-walls, give thickness thereof, ..... inches.
8. With what material will walls be coped? .....
9. What will be the materials of front? ..... If of stone, what kind .....  
Give thickness of front ashlar, ....., and thickness of backing thereof, .....
10. Will the roof be flat, peak, or mansard? .....
11. What will be the materials of roofing? .....
12. Give size and material of floor beams, 1st tier, ..... x .....; 2d tier,  
..... x .....; 3d tier, ..... x .....; 4th tier, ..... x .....; 5th  
tier, ..... x .....; 6th tier, ..... x .....; roof tier, .....  
..... x ..... State distance from centres on 1st tier ..... inches; 2d tier, ..... inches;  
3d tier, ..... inches; 4th tier, ..... inches; 5th tier, ..... inches; 6th tier,  
..... inches; roof tier, ..... inches.
13. If floors are to be supported by columns and girders, give the following information: Size and  
material of girders under 1st floor, ..... x ..... under upper floors, .....  
..... Size and material of columns under  
1st floor, ..... under upper floors, .....
14. If the front, rear or side walls are to be supported, in whole or in part, by iron girders or lintels,  
give definite particulars, .....
15. If girders are to be supported by brick piers and columns, state the size of piers and columns.  
.....
16. How will the extension be connected with present or main building? .....
17. How will the extension be occupied? If for dwelling purposes, state how many families are to  
occupy each floor, .....


IF ALTERED INTERNALLY, GIVE DEFINITE PARTICULARS AND STATE HOW THE BUILDING WILL BE OCCUPIED:

IF THE FRONT, REAR, OR SIDE WALLS, OR ANY PORTION THEREOF, ARE TO BE TAKEN OUT AND REBUILT, GIVE DEFINITE PARTICULARS, AND STATE IN WHAT MANNER:

Old openings in cellar which have been built up to be reopened and new sashes and doors put in same. New front and rear areas to be built as per plan, walls of brick 16" thick with proper copings and railings. No supports to be disturbed. Lintels over above openings are good stone lintels in good condition.

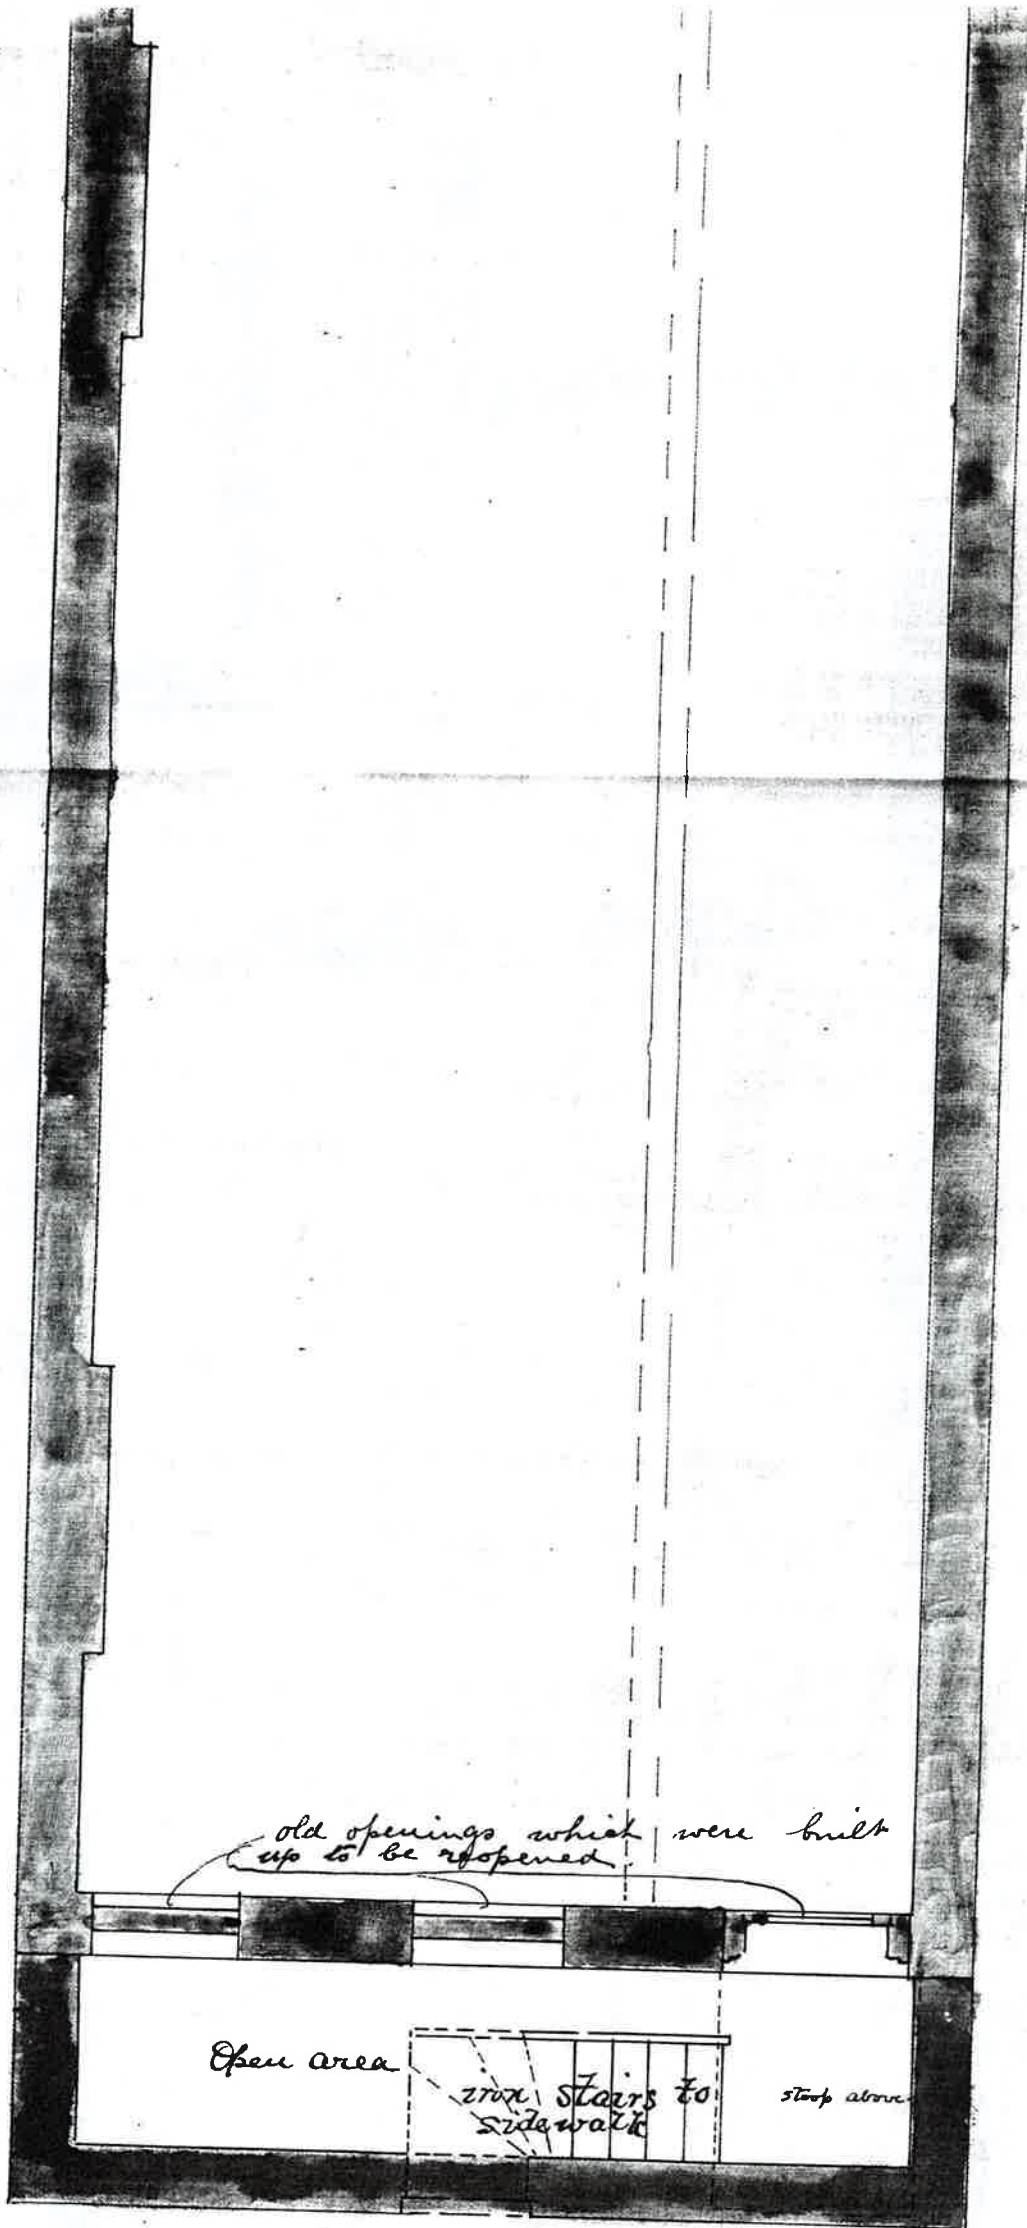

Basement Plan.  
 543 East 11<sup>th</sup> Str.  
 1/4 Scale.  
 # 177 All.  
 of 1888.

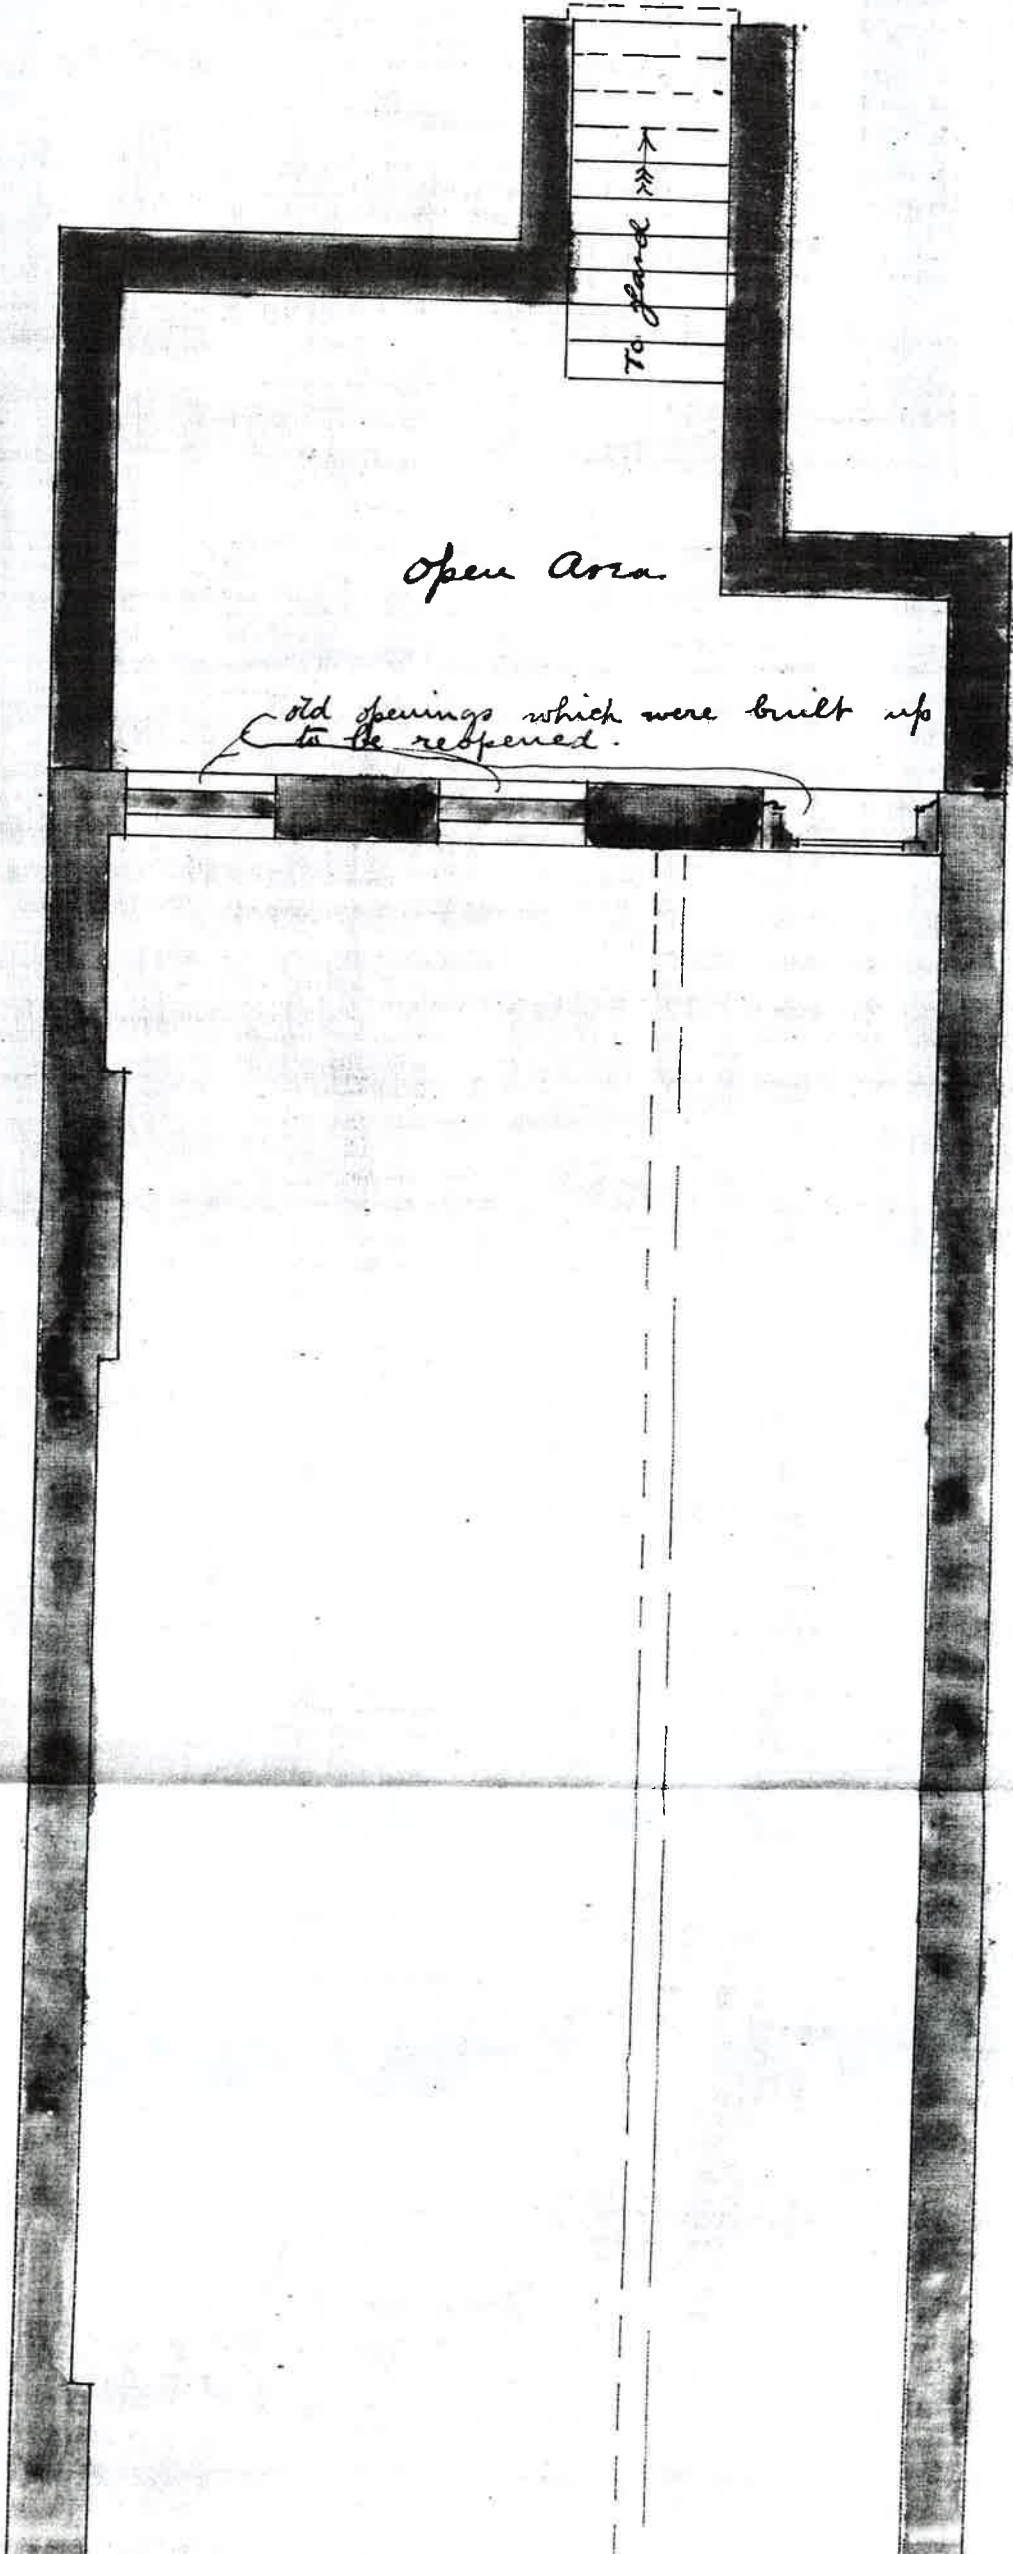

Open Area

old openings which were built up to be reopened.

To land

2796

Applicant must indicate the Building Line or Lines clearly and distinctly on the drawings.

Plan No. 2796

DEC 21 1899

2

B405  
L39  
41

# APPLICATION TO ALTER, REPAIR, Etc.

Application is hereby made to the Commissioner of Buildings of The City of New York, for the Boroughs of Manhattan and The Bronx, for the approval of the detailed statement of the specifications and plans herewith submitted, for the alteration or repair of the building herein described. All provisions of the Building Law shall be complied with in the alteration or repair of said building, whether specified herein or not.

(Sign here) Jullade + Parker

NEW YORK, Dec 21<sup>st</sup> 189 9

1. State how many buildings to be altered. one
2. What is the street or avenue and the number thereof? Give diagram of property. # 543 + 545 East 11<sup>th</sup> St. N.Y.C. Manhattan
3. How much will the alteration cost? \$ 15 000.00

### GIVE THE FOLLOWING INFORMATION AS TO THE PRESENT BUILDING:

1. Size of lot on which it is located, No. of feet front, 60'-0"; feet rear, 60'-0"; feet deep, 102'-10"
2. Size of building, No. of feet front, 60'-0"; feet rear, 60'-0"; feet deep, 102'-10" No. of stories in height, 4; No. of feet in height from curb level to highest point of beams, 40'-0"
3. Material of building, Bricks wood fl. beams; material of front, Brick
4. Whether roof is peak, flat, or mansard, Flat + gipped
5. Depth of foundation walls, 7'-8'-0" feet; thickness of foundation walls, 16" + 20" + 24" materials of foundation walls, Brick + Stone
6. Thickness of upper walls, 16" + 12" inches. Material of upper walls, Brick
7. Whether independent or party walls, West + Center wall party. East wall independent.
8. How the building is or was occupied, Church + tenement.

### IF TO BE RAISED OR BUILT UPON, GIVE THE FOLLOWING INFORMATION:

1. How many stories will the building be when raised? /
2. How high will the building be when raised? /
3. Will the roof be flat, peak, or mansard? /
4. What will be the thickness of wall of additional stories? / story, / inches; / story, / inches.
5. Give size and material of floor beams of additional stories; / 1st tier, /, / x / 2d tier, /, / x / Distance from centres on / tier, / inches; / tier / inches.
6. How will the building be occupied? /

### IF TO BE EXTENDED ON ANY SIDE, GIVE THE FOLLOWING INFORMATION.

1. Size of extension, No. feet front, 20'-0"; feet rear, 20'-0"; feet deep, 42'-10"; No. of stories in height, 5; No. of feet in height, 56'-0"
2. What will be the material of foundation walls of extension? Brick. What will be the depth? 9'-8" feet. What will be the thickness? 20" inches.
3. Will foundation be laid on earth, sand, rock, timber or piles? Earth.



Owner Methodist Church Extension Address 150 Fifth Ave N.Y.C.  
 Architect Jallode & Barker Address 134 East 25<sup>th</sup> St.  
 Mason \_\_\_\_\_ Address \_\_\_\_\_  
 Carpenter \_\_\_\_\_ Address \_\_\_\_\_  
*Contract not yet let masonry to be finished later*

**REPORT UPON APPLICATION.**

**Department of Buildings of The City of New York.**

**BOROUGH OF MANHATTAN AND THE BRONX.**

NEW YORK, Dec. 30 1899

To the Commissioner of Buildings for the Boroughs of Manhattan and The Bronx:

I respectfully report that I have thoroughly examined and measured the building, walls, etc., named in the foregoing application, and found the foundation wall to be built of Brick & Stone 16x20 inches thick, 7 feet below curb, the upper wall built of Brick 16x12 inches thick, 100-10 feet deep, 40 feet in height, and that the mortar in said walls is hard and good, and that all the walls are in good and safe condition.

What is the nature of the ground? Not visible

What kind of sand was used in the mortar? Sharp

How is or was the building occupied?

(The Inspector must here state what defects, if any, are in the walls, beams or other part of the building.)

(The Inspector must state the thickness of each wall in each and every story.)

Foundation walls built of brick & Stone 16" 20" x 24" thick  
Upper walls built of brick. 1<sup>st</sup> story 16"  
2, 3, 4 stories 12" thick, in good condition at present

W. L. Anderson Inspector.

**THE BUILDING LAW REQUIRES:**

- 1st—That all stone walls shall be properly bonded and laid in cement mortar.
- 2d—That all skylights having a superficial area of more than nine square feet, placed in any building, shall have the sashes and frames thereof constructed of iron and glass.
- 3d—That every building which is more than two stories in height above the curb level, except dwelling-houses, hotels, school-houses and churches, shall have doors, blinds or shutters made of iron, hung to iron hanging frames or to iron eyes built into the wall, on every window and opening above the first story thereof, excepting on the front openings of buildings fronting on streets which are more than thirty feet in width. Or the said doors, blinds or shutters may be constructed of pine or other soft wood of two thicknesses of matched boards at right angles with each other, and securely covered with tin, on both sides and edges, with folded lapped joints, the nails for fastening the same being driven inside the lap; the hinges and bolt, or latches shall be secured or fastened to the door or shutter after the same has been covered with the tin, and such doors or shutters shall be hung upon an iron frame, independent of the woodwork of the windows and doors, or two iron hinges securely fastened in the masonry; or such frames, if of wood, shall be covered with tin in the same manner as the doors and shutters.
- 4th—That outside fire escapes shall be placed on every dwelling-house occupied by or built to be occupied by three or more families above the first story, and every building already erected, or that may hereafter be erected, more than three stories in height, occupied and used as a hotel or lodging-house, and every boarding-house, having more than fifteen sleeping-rooms above the basement story, and every factory, mill, manufactory or workshop, hospital, asylum or institution for the care or treatment of individuals, and every building in whole or in part occupied or used as a school or place of instruction or assembly, and every office building five stories or more in height, all to be constructed as follows:

**BALCONIES MUST NOT BE LESS THAN THREE FEET WIDE.**

- BRACKETS must not be less than  $\frac{1}{2} \times 1\frac{3}{4}$  inches wrought iron, placed edgewise, or  $1\frac{1}{2}$  inch angle iron  $\frac{1}{4}$  inch thick, well braced, and not more than three feet apart, and the braces to brackets must be not less than  $\frac{3}{4}$  inch square wrought iron, and must extend two-thirds of the width of the respective brackets or balconies. In all cases the brackets must go through the wall, and be turned down three inches.
- BRACKETS ON NEW BUILDINGS must be set as the walls are being built. When brackets are to be put on old houses, the part going through the wall shall not be less than one inch diameter, with screw nuts and washers not less than five inches square and  $\frac{1}{2}$  inch thick.
- TOP RAILS.—The top rail of balcony must be  $1\frac{3}{4}$  inch x  $\frac{3}{8}$  inch wrought iron or  $1\frac{1}{2}$  inch angle iron  $\frac{1}{4}$  inch thick, and in all cases must go through the walls, and be secured by nuts and 4 inch square washers, at least  $\frac{3}{8}$  inch thick, and no top rail shall be connected at angles by the use of cast iron.
- BOTTOM RAILS.—Bottom rails must be  $1\frac{1}{4}$  inch x  $\frac{3}{8}$  inch wrought iron or  $1\frac{1}{2}$  inch angle iron  $\frac{1}{4}$  inch thick, well leaded into the wall. In frame buildings the top rails must go through the studding and be secured on the inside by washers and nuts as above.
- FILLING-IN BARS.—The filling-in bars must be not less than  $\frac{1}{2}$  inch round or square wrought iron, placed not more than 6 inches from centres, and well riveted to the top and bottom rails.
- STAIRS.—The stairs in all cases must be not less than 18 inches wide, and constructed of  $\frac{1}{4} \times 3\frac{1}{2}$  inch wrought iron sides or strings. Steps may be of cast iron of the same width of strings, or  $\frac{9}{8}$  inch round iron, double rungs, and well riveted to the strings. The stairs must be secured to a bracket on top and rest on and be secured to a bracket or extra cross bar at the bottom. All stairs must have a  $\frac{1}{4}$  inch hand rail of wrought iron, well braced.
- FLOORS.—The flooring of balconies must be of wrought iron  $1\frac{1}{2} \times \frac{3}{8}$  inch slats placed not over  $1\frac{1}{2}$  inches apart, and secured to iron battens  $1\frac{1}{2} \times \frac{3}{8}$  inch, not over nine covers.
- DROP LADDERS.—Drop ladders from lower balconies where required shall not be less than 14 inches wide, and shall be made of  $1\frac{1}{2} \times \frac{9}{8}$  inch sides and  $\frac{5}{8}$  inch rungs of wrought iron. In no case shall a drop ladder be more than 12 feet in length. In no case shall the ends of balconies extend more than nine inches over the brackets.
- SCUTTLE LADDERS.—Ladders to scuttles shall be constructed in all cases the same as the stairs or step-ladders from balconies of fire escapes.
- THE HEIGHT OF RAILING around balconies shall not be less than two feet nine inches.

No Fire Escape will be approved by the Commissioner of Buildings for the Boroughs of Manhattan and The Bronx if not in accordance with above specifications.

In constructing all balcony fire-escapes, the manufacturer thereof shall securely fasten thereto, in a conspicuous place, a cast-iron plate, having suitable raised letters on the same, to read as follows: Notice! Any person placing any incumbrance on this balcony is liable to a penalty of ten dollars and imprisonment for ten days.

- 5th—That all exterior and division or party walls over fifteen feet high, excepting where such walls are to be finished with cornices, gutters or crown mouldings, shall have parapet walls carried two feet above the roof, and shall be coped with stone, well-burnt terra-cotta or cast iron.
- 6th—That every building and the tops and sides of every dormer-window thereon shall be covered and roofed with slate, tin, copper or iron, or such other quality of fire-proof roofing as the superintendent of buildings, under his certificate, may authorize.
- 7th—That all exterior cornices shall be fire proof.
- 8th—That the stone or brick work of all smoke flues, and the chimney shafts of all furnaces, boilers, bakers' ovens, large cooking ranges and laundry stoves, and all flues used for a similar purpose, shall be at least eight inches in thickness. If there is a cast-iron or burnt clay pipe built inside of the same, with one-inch air space all around it, then the stone or brick work inclosing such pipes shall not be less than four inches in thickness.
- 9th—That before any iron or steel beam, lintel or girder intended to span an opening over ten feet in length in any building, shall be used for supporting a wall, it shall be inspected, tested and approved as provided by law.





New York, Oct 6<sup>th</sup> 1990Amendment to Application No. 2796 Alt B. 1899Location # 543-545+547 East 11<sup>th</sup> St N.Y. CityViolation # 6560.

Application is made to change 20" wall (East wall of rear extension of # 543 to a 12" wall building same against present rubble wall (20") using drive anchors spaced every other feet vertically & horizontally.

This wall is to be built up one story of 13<sup>th</sup> feet. see new drawing filed.

Violation # 6561.

Chimneys & Flues on easterly wall will be capped according to law before completion of these buildings.

Violation # 6388.

Bulk head is fireproofed with wire lath & fireproofing material.

Violates # 6417

In place of one 8x8 Y.P. post supporting part of church gallery as shown, will substitute a 6" C.I. col. 3/4 metal, resting on a 5 1/2 x 16 x 16 B.S. Taperlet, which rests on a 16" brick wall as shown. on top of this col. a 1 1/2 x 10 x 14 C. steel plate on which will rest one end of the 12" steel girder.

A 12" I 31.5 lbs. will be substituted for the 10x12 Y.P. girder called for in old plans this beam to have one end resting on a 12" x 3-3" brick pier to cellar 16" wall. The 10x12 Y.P. girder will have one end resting on the steel plate & other end in east wall, all as shown on new plans filed this day.

Violation # 6416, 20x20 BK pier not shown on last set of approved plans.Unsafe # 2560.

Ends of beams referred to are left in such condition as will permit working around same & will be properly taken care of in time replacing any rotten or broken beams.

Inspection on back L. J. Gallay

Jallade & Barde  
242 West 76<sup>th</sup> St.

THOMAS J. BRADY,

President of the Board of Buildings and  
Commissioner of Buildings for the Bor-  
oughs of Manhattan and The Bronx.Office, No. 220 Fourth Avenue, S.W. cor. 18th Street,  
Borough of Manhattan.

JOHN GUILFOYLE,

Commissioner of Buildings for  
the Borough of Brooklyn.

Office, Borough Hall, Borough of Brooklyn.

DANIEL CAMPBELL,

Commissioner of Buildings for the Bor-  
oughs of Queens and Richmond.Office, Richmond Building, New Brighton, Staten Island,  
Borough of Richmond.Branch Office, Town Hall, Jamaica, Long Island,  
Borough of Queens.Borough of ManhattanThe City of New York, September 24 1900Amendment to Application No. 2796

B, 190

Location 7 543 + 545 East 11<sup>th</sup> St. ManhattanViolation no 6416.In regard to 20" x 20" brick piers in  
no 545

On July 31, 1900 we filed a new set of amended plans which were approved. In these plans the posts supporting girders which carried floor beams of Church parlor in no 545 were shown to rest on 12" x 12" x 8" Blue stone templates which were built in to a 16" brick continuous wall. This was approved by the Building Department and these plans have been followed.

Violation no 6417.In regard to wooden girders and posts.  
in no 545.

On the approved plans filed on July 31, 1900. 8" x 8" yellow pine posts were shown supporting girder which carries Church parlor floor beams. Said girder was not specified in plans. When constructing one 6" <sup>3/4"</sup> cast iron column was used in place of 8" x 8" yellow pine post. and one 12" I 30<sup>#</sup> was used instead of wooden girder which rests on 1 1/4" steel plate on top of column. The remaining span is spanned by a 10" x 12" yellow pine girder supported in the center by yellow pine post as shown on drawings approved by the Department.

Gallagher &amp; Carter, Inc.

10/2/00

Applicant must indicate the Building Line or Lines clearly and distinctly on the drawings.

Plan No. 2796

# APPLICATION TO ALTER, REPAIR, Etc.

Application is hereby made to the Commissioner of Buildings of The City of New York, for the Boroughs of Manhattan and The Bronx, for the approval of the detailed statement of the specifications and plans herewith submitted, for the alteration or repair of the building herein described. All provisions of the Building Law shall be complied with in the alteration or repair of said building, whether specified herein or not.

(Sign here)

*J. J. Baker*

NEW YORK,

Dec 21<sup>st</sup>

1899

1. State how many buildings to be altered. one
2. What is the street or avenue and the number thereof? Give diagram of property. # 543 + 545 East 11<sup>th</sup> St. N.Y.C. Manhattan.
3. How much will the alteration cost? \$ 15,000.00

### GIVE THE FOLLOWING INFORMATION AS TO THE PRESENT BUILDING:

1. Size of lot on which it is located, No. of feet front, 60'-0"; feet rear, 60'-0"; feet deep, 102'-10"
2. Size of building, No. of feet front, 60'-0"; feet rear, 60'-0"; feet deep, 100'-10" No. of stories in height, 4; No. of feet in height from curb level to highest point of beams, 40'-0"
3. Material of building, Brick - Wood joists; material of front, Brick
4. Whether roof is peak, flat, or mansard, Flat & hipped
5. Depth of foundation walls, 7'-8" feet; thickness of foundation walls, 16" x 20" x 24"; materials of foundation walls, Brick & stone
6. Thickness of upper walls, 16" x 12" inches. Material of upper walls, Brick
7. Whether independent or party walls, West & Centre were party, East line independent
8. How the building is or was occupied, Croquet & Amusement

### IF TO BE RAISED OR BUILT UPON, GIVE THE FOLLOWING INFORMATION:

1. How many stories will the building be when raised?
2. How high will the building be when raised?
3. Will the roof be flat, peak, or mansard?
4. What will be the thickness of wall of additional stories? \_\_\_\_\_ story, \_\_\_\_\_ inches; \_\_\_\_\_ story, \_\_\_\_\_ inches.
5. Give size and material of floor beams of additional stories; \_\_\_\_\_ 1st tier, \_\_\_\_\_, \_\_\_\_\_ 2d tier, \_\_\_\_\_, \_\_\_\_\_ Distance from centres on \_\_\_\_\_ tier, \_\_\_\_\_ inches; \_\_\_\_\_ tier \_\_\_\_\_ inches.
6. How will the building be occupied?

### IF TO BE EXTENDED ON ANY SIDE, GIVE THE FOLLOWING INFORMATION.

1. Size of extension, No. feet front, 20'-0"; feet rear, 20'-0"; feet deep, 42'-10"; No. of stories in height, 5; No. of feet in height, 50'-0"
2. What will be the material of foundation walls of extension? Brick. What will be the depth? 8'-8" feet. What will be the thickness? 20" inches.
3. Will foundation be laid on earth, sand, rock, timber or piles? Earth

IF TO BE EXTENDED ON ANY SIDE GIVE THE FOLLOWING INFORMATION.

4. What will be the base, stone or concrete? Concrete If base stones, give size and thickness and how laid, \_\_\_\_\_ If concrete, give thickness, 12"
5. What will be the sizes of piers? \_\_\_\_\_ What will be the sizes of the base of piers? \_\_\_\_\_
6. What will be the thickness of upper walls? 1st story, 16" inches; 2d story, 12" inches; 3d story, 12" inches; 4th story, 12" inches; 5th story, 12" inches; 6th story, \_\_\_\_\_ inches; 7th story, \_\_\_\_\_ inches; from thence to top, 12" inches; and of what materials to be constructed, Brick + Cement mortar
7. State whether independent or party-walls. Party on side If party-walls give thickness thereof, 20" + 16"
8. With what material will walls be coped? Blue Stone Coping
9. What will be the materials of front? Brick If of stone, what kind? \_\_\_\_\_ Give thickness of front ashlar, \_\_\_\_\_ Give thickness of backing, \_\_\_\_\_
10. Will the roof be flat, peaked or mansard? flat
11. What will be the materials of roofing? tin
12. Give size and material of floor beams, 1st tier, Y.Pine, 2" x 12"; 2d tier, Y.Pine, 2" x 12"; 3d tier, Y.P., 2 x 12; 4th tier, Y.P., 2" x 12"; 5th tier, \_\_\_\_\_; 6th tier, \_\_\_\_\_; 7th tier, \_\_\_\_\_; roof tier, Y.P., 2" x 10" State distance from centres on 1st tier, 20" inches; 2d tier, 20" inches; 3d tier, 20" inches; 4th tier, 20" inches; 5th tier, 20" inches; 6th tier, \_\_\_\_\_ inches; 7th tier, \_\_\_\_\_ inches; roof tier, 20" inches
13. If floors are to be supported by columns and girders, give the following information: Size and material of girders under 1st floor, gallery, 12" I 30.5 under each of the upper floors, \_\_\_\_\_ Size and material of columns under first floor, \_\_\_\_\_ under each of the upper floors, \_\_\_\_\_
14. If the front, rear or side walls are to be supported, in whole or in part, by iron girders or lintels, give definite particulars, front wall supported on 2-24" I # 80 with B.S. Template 2'-6" x 4'-6" x 8" set on Rk. Wall side wall supported on 2-15" I # 42 set on end on 16" x 16" x 1" steel plate set on Rk. wall.
15. If girders are to be supported by brick piers and columns, state the size of piers and columns. gallery girders supported by C.I. Columns 6" diam of metal
16. How will the extension be connected with present or main building? 4" chan will be cut into into old wall + new one built into chan. 20x20 B
17. How will the extension be occupied? If for dwelling purposes, state how many families are to occupy each floor. club house
18. State who will superintend the alterations. Jallade + Barber Architects

IF ALTERED INTERNALLY, GIVE DEFINITE PARTICULARS AND STATE HOW THE BUILDING WILL BE OCCUPIED:

Stairs changed, new windows in center wall partition doors + windows changed 1st story front + Rear  
new gallery in auditorium, occupied as club house

IF THE FRONT, REAR, OR SIDE WALLS, OR ANY PORTION THEREOF, ARE TO BE TAKEN OUT AND REBUILT, GIVE DEFINITE PARTICULARS, AND STATE IN WHAT MANNER:

Front wall = door changed into window  
Rear wall = door changed into window  
center wall, connecting doors + windows to be cut. Use lintels over these doors

# DEPARTMENT OF BUILDINGS OF THE CITY OF NEW YORK.

Boroughs of Manhattan and the Bronx.

Plan No. 2796

ALTERATIONS OF 1899.

STATE OF NEW YORK  
City and County of New York,

} ss.:

DEC 27 1899

FOR THE

L. J. Gallade

the

Architect

of premises

hereinafter described, being duly sworn, deposes and says: That Methodist Extension Society

who resides at No. 150 5th Ave N.Y. City in the City of

New York

in the County of

New York

in the State of New York ~~is~~ the owner <sup>under contract</sup> in fee of all that certain lot, piece

or parcel of land, shown on the diagram annexed hereto and made a part hereof, situate, lying and

being in the City and County of New York, known and designated as No. 543 & 545 East 11th St

N.Y. City Manhattan

, and bounded and described as follows, viz.:

BEGINNING at a point on the North side of 11th St.

distant 100'-0" feet West from the corner

formed by the intersection of 11th St. & Ave B.

running thence 60'-0" West

thence 102'-10" North

thence 60'-0" East

thence 102'-10" South

to the point or place of beginning.

Deponent further says that the alterations proposed to be made, in the building erected upon the said premises in accordance with the accompanying detailed statement in writing of the specifications and plans therefor, will be made by or on account of the following person, whose full name, residence and interest as follows:

Methodist Extension Society No. \_\_\_\_\_

as by whom this work is authorized as  
owner under contract No. \_\_\_\_\_

Rev Dr F. M. North No. 150 5th Ave N.Y. City

as Secretary of Methodist Extension Society  
No. \_\_\_\_\_

L. J. Gallade No. 134 East 25th St N.Y.C.  
as Architect 242 W. 76 St.

being the only person interested in said building

Sworn to before me, this

21 day of Dec 1899.

P. J. McInley  
Commissioner of Records  
New York City Rec.

L. J. Gallade

DEPARTMENT OF BUILDINGS  
CITY OF NEW YORK  
Received JUL 31 1899  
FOR THE BOROUGHS OF  
MANHATTAN & THE BRONX.

By  
JULY 31 1900  
New York, July 31 1900  
Commissioner of Buildings for the  
City of New York

Amendment to Application No. 2746

Location # 543 & 545 East 11<sup>th</sup> St N.Y. City

John J. Grady  
Commissioner of Buildings for the  
City of New York

New extension at rear of # 543 to be made  
one story high only in place of 5<sup>th</sup> story  
walls, footings & first tier of beams  
being left of size as shown on old  
set of plans, so, that additional story  
may be built in later

Church gallery in # 545 left out  
Present brick pier in basement of # 545  
removed & new 8x12 Y.P. girders put in  
place of present girders  
Coal vault under side walk omitted.  
new area retaining wall in front of 543 &  
part of 545 retained  
Door & Windows in basement of 545 as  
shown in place of present windows at Bldg.  
Pump water in 543 omitted  
In 1<sup>st</sup> floor 545 window in place of door  
in present Bldg & door in place of window  
Floor beams of 2<sup>nd</sup> floor of 545 made  
level & old stair well framed up.  
Deck base on roof of 543 changed to  
bulk head.

New water tanks on roof of 543.  
Iron pipes in place of all proposed changes  
Construction  
Aug 15 1900  
L.S. Jallard  
Please see Jallard & Barber  
Martin J. Haerdt

with specifications and a copy of  
the same to the  
base of the  
dated...

1/11 1900

This is to certify that the within and a copy of the same have been submitted to the Commission of the City of New York, Manhattan and the Boroughs of Manhattan and the Bronx and are hereby approved.

DEPARTMENT OF BUILDINGS CITY OF NEW YORK, Boroughs of Manhattan and The Bronx,

No. 220 FOURTH AVENUE.

New York, Jan. 10<sup>th</sup>

DEPARTMENT OF THE CITY OF NEW YORK  
BOROUGH OF MANHATTAN  
JAN 10 1900  
FOR THE BOROUGH OF MANHATTAN & THE BOROUGH OF THE BRONX

John A. Loner  
Supt. of Buildings  
Commissioner of Buildings  
Boroughs of Manhattan and the Bronx

Amendment to Application No. 2786

B. 189

Location # 543 + 545 East 11<sup>th</sup> St N.Y.C. (Manhattan)

- # 1. All floor & Roof beams will be made 3 inches wide  
floor beams 3"x12" Roof beam 3"x10"
- # 2. Wooden roof girders on roof will be omitted.
- # 3. Roof garden will be omitted. & present roof left as at present. that is wood beams & tin covering
- # 4. Proper fire escapes will be provided at window in connecting passage between old & extension on light court.  
Present fire escapes will be retained on front of side.
- # 5. The side court wall will be strengthened see plans  
brick mullion will be made 2'-0" in place of 16" inches.
- # 6. Galley will be properly anchored to side wall by wrought iron anchors. run through wall & fastened to outside of wall & sides of beams.

Construction  
Jan 11 1900

Application is made to change 3'-0" ft door shown on 1st fl. plan marked X to 8'-0" ft door with iron lintel over made of 2-9" L #15 & 1 9" I #21 set in Blue stone tablets

L. J. Gallah

1/10/1900